


Schemat typ "B4"

STr-3.03, 3.04


230VAC/24VAC, 10A, TN-S

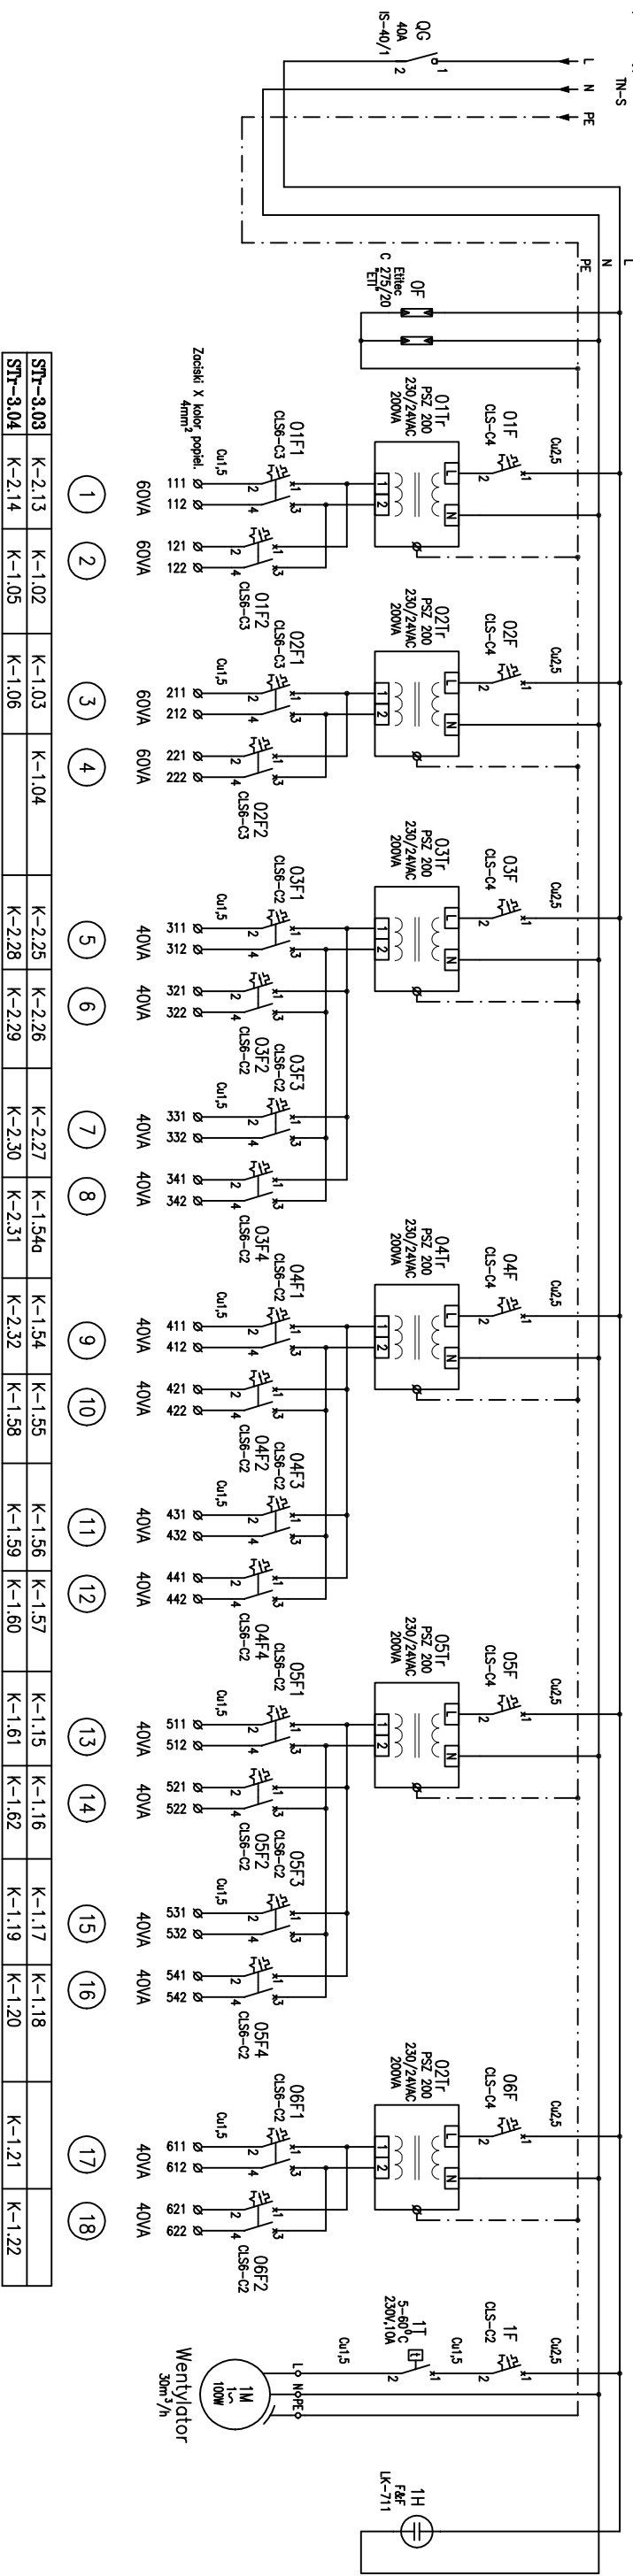


Schemat typ "B2"

STr-2.03, 2.04

230VAC/24VAC, 10A, TN-S

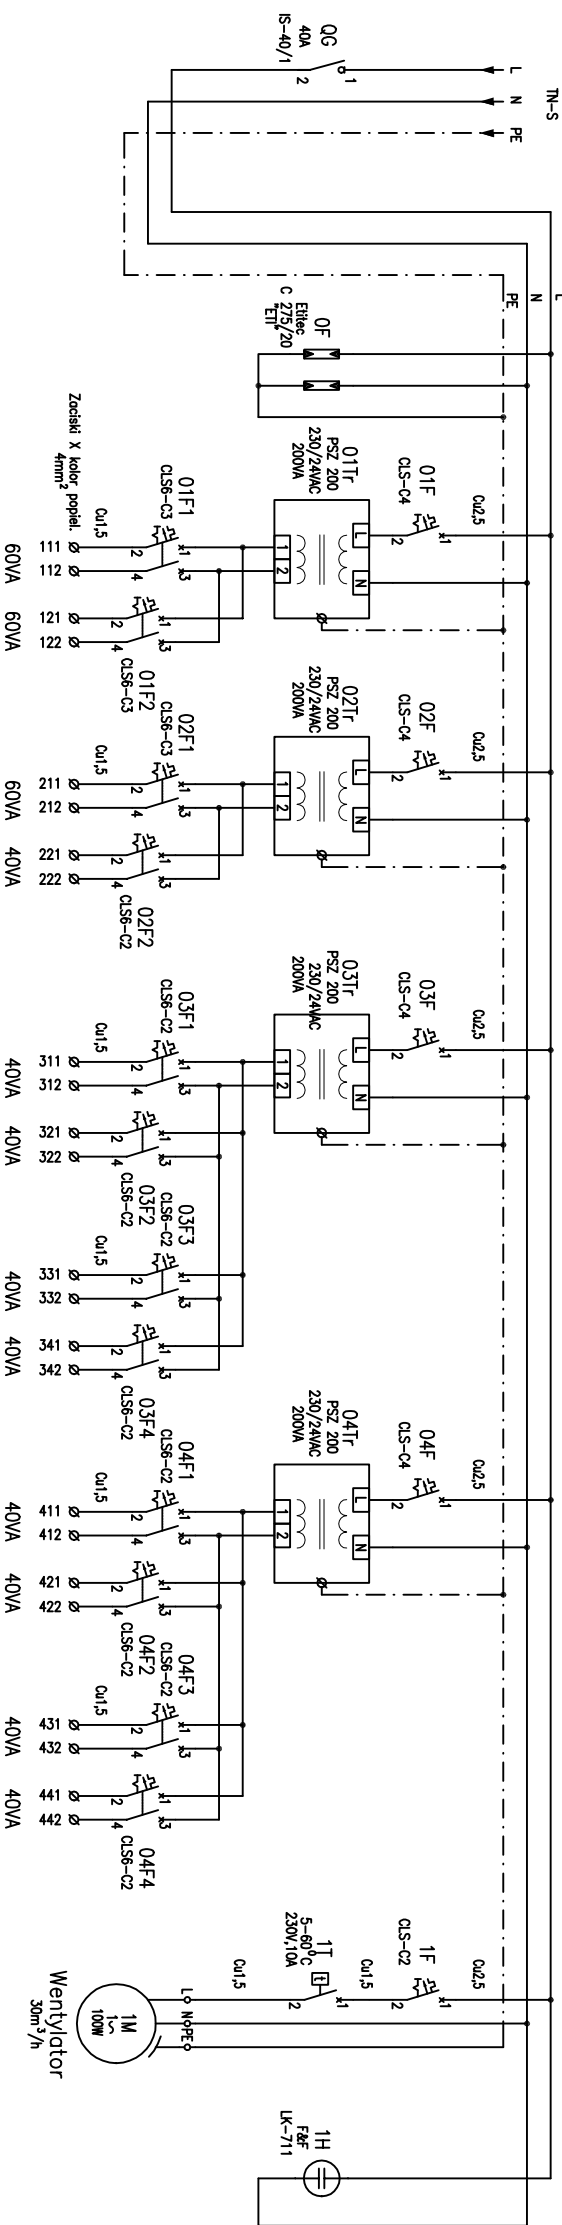

STr-2.03	K-2.12	K-2.02	K-2.03		K-2.24	K-1.14	K-1.53	K-0.11	K-0.12	K-0.52	K-0.85	
STr-2.04	K-2.11	K-1.01			K-2.21	K-2.22	K-2.23	K-1.51	K-1.52	K-1.11	K-1.12	K-1.13



STUDIO PROJEKTOWE ANNY KASPRZYK

02-634 Warszawa, ul. Miłobedzka 23

e-mail: spak@spak.com.pl

tel./fax 844 88 81

www.spak.com.pl

Brzoza

INSTALACJE NAGŁOŚNIENIA I MONITORINGU

Nr. Rys. W-T-IT-AV-2698

Arkusz: 5

W-T-IT-AV-2698

Few. 01